

Figure 1

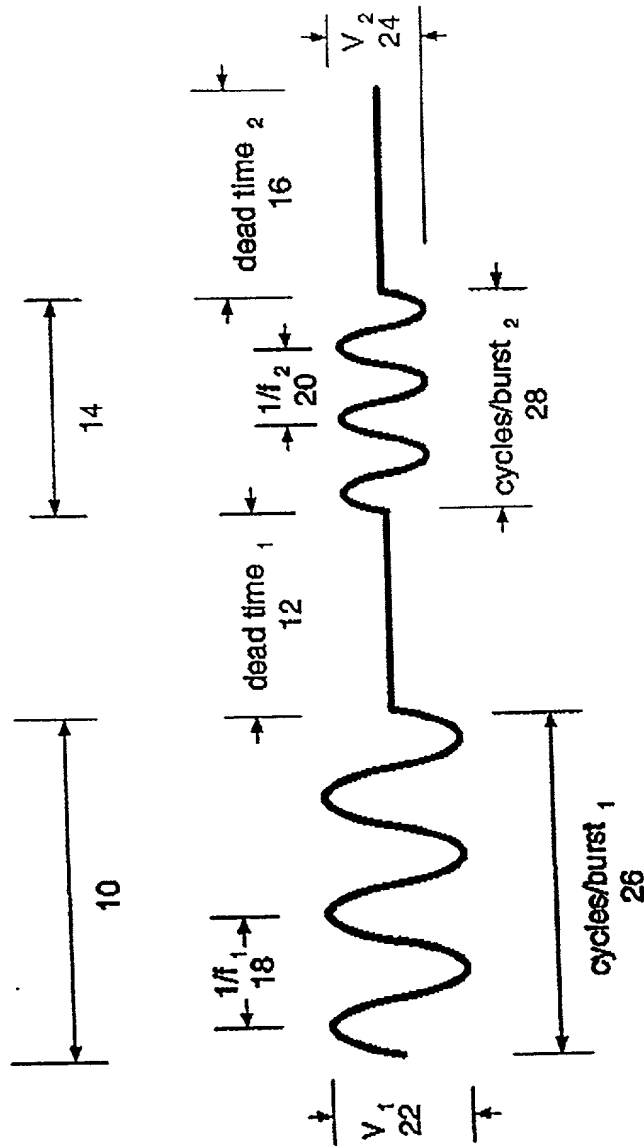


Figure 2






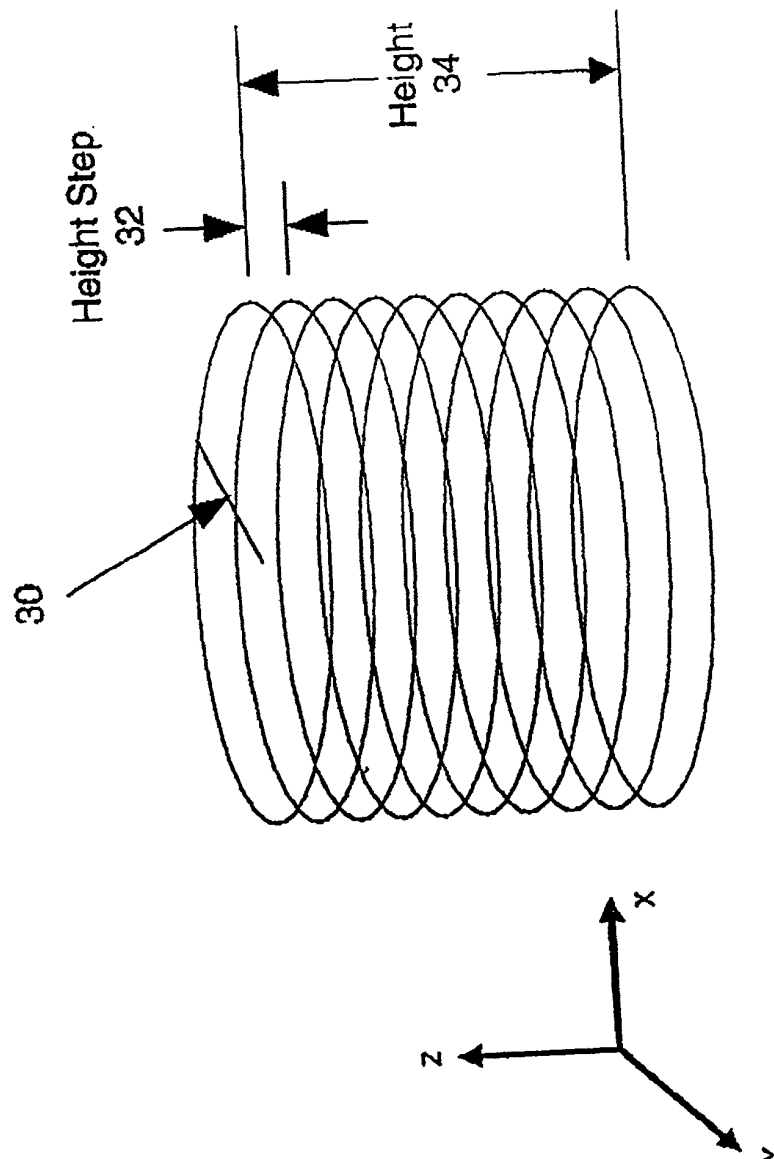


Figure 3




# post-treatment transfer

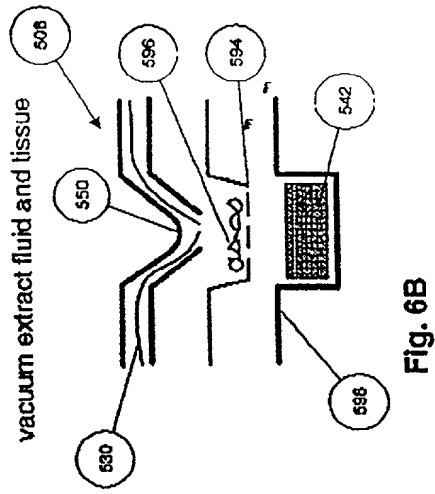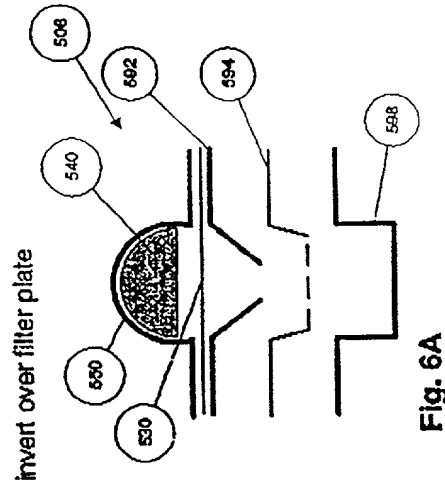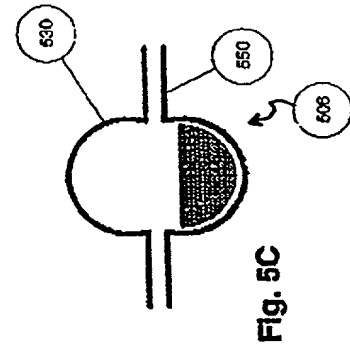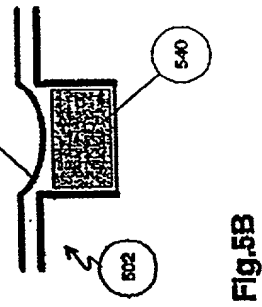

# pre-treatment assembly

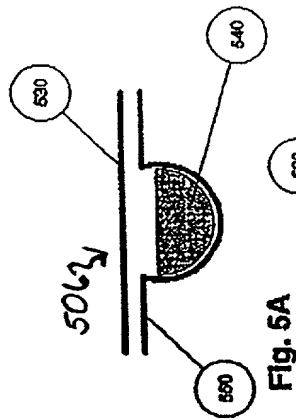

# treatment vessels

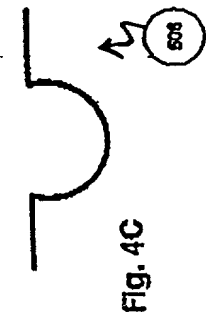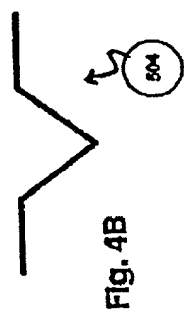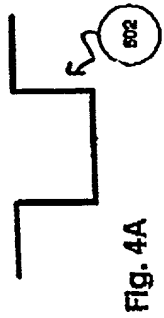

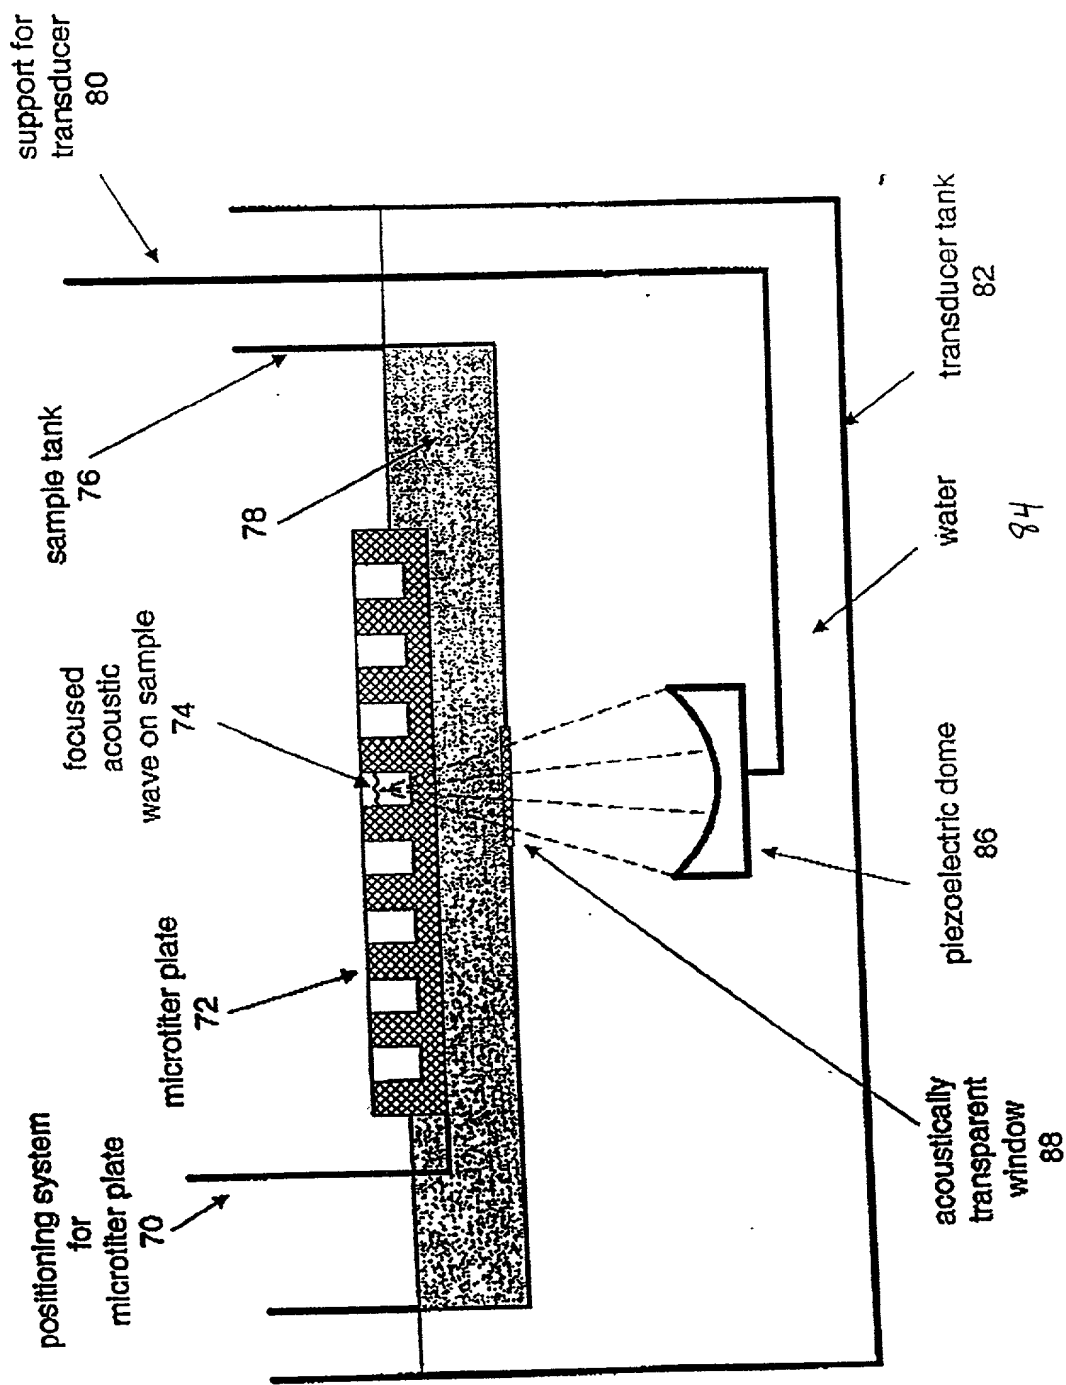


Figure 7



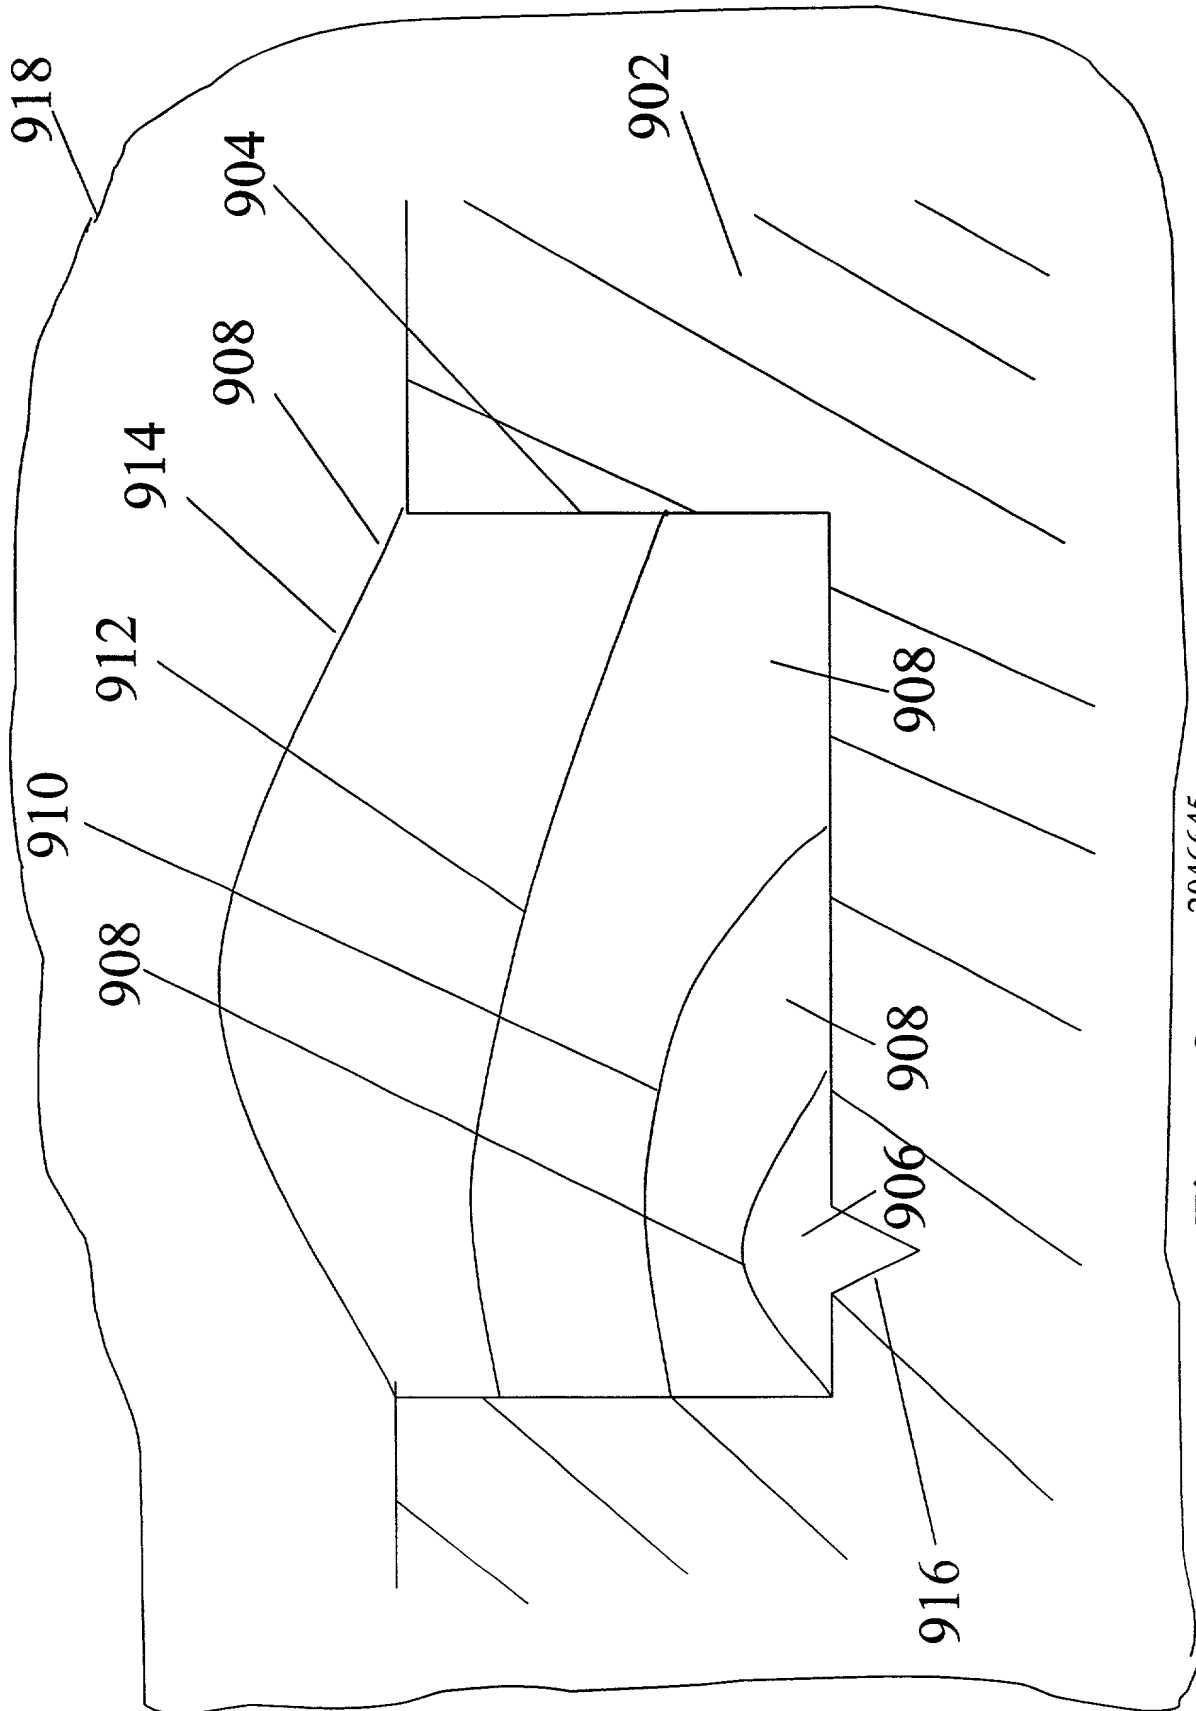


Figure 9

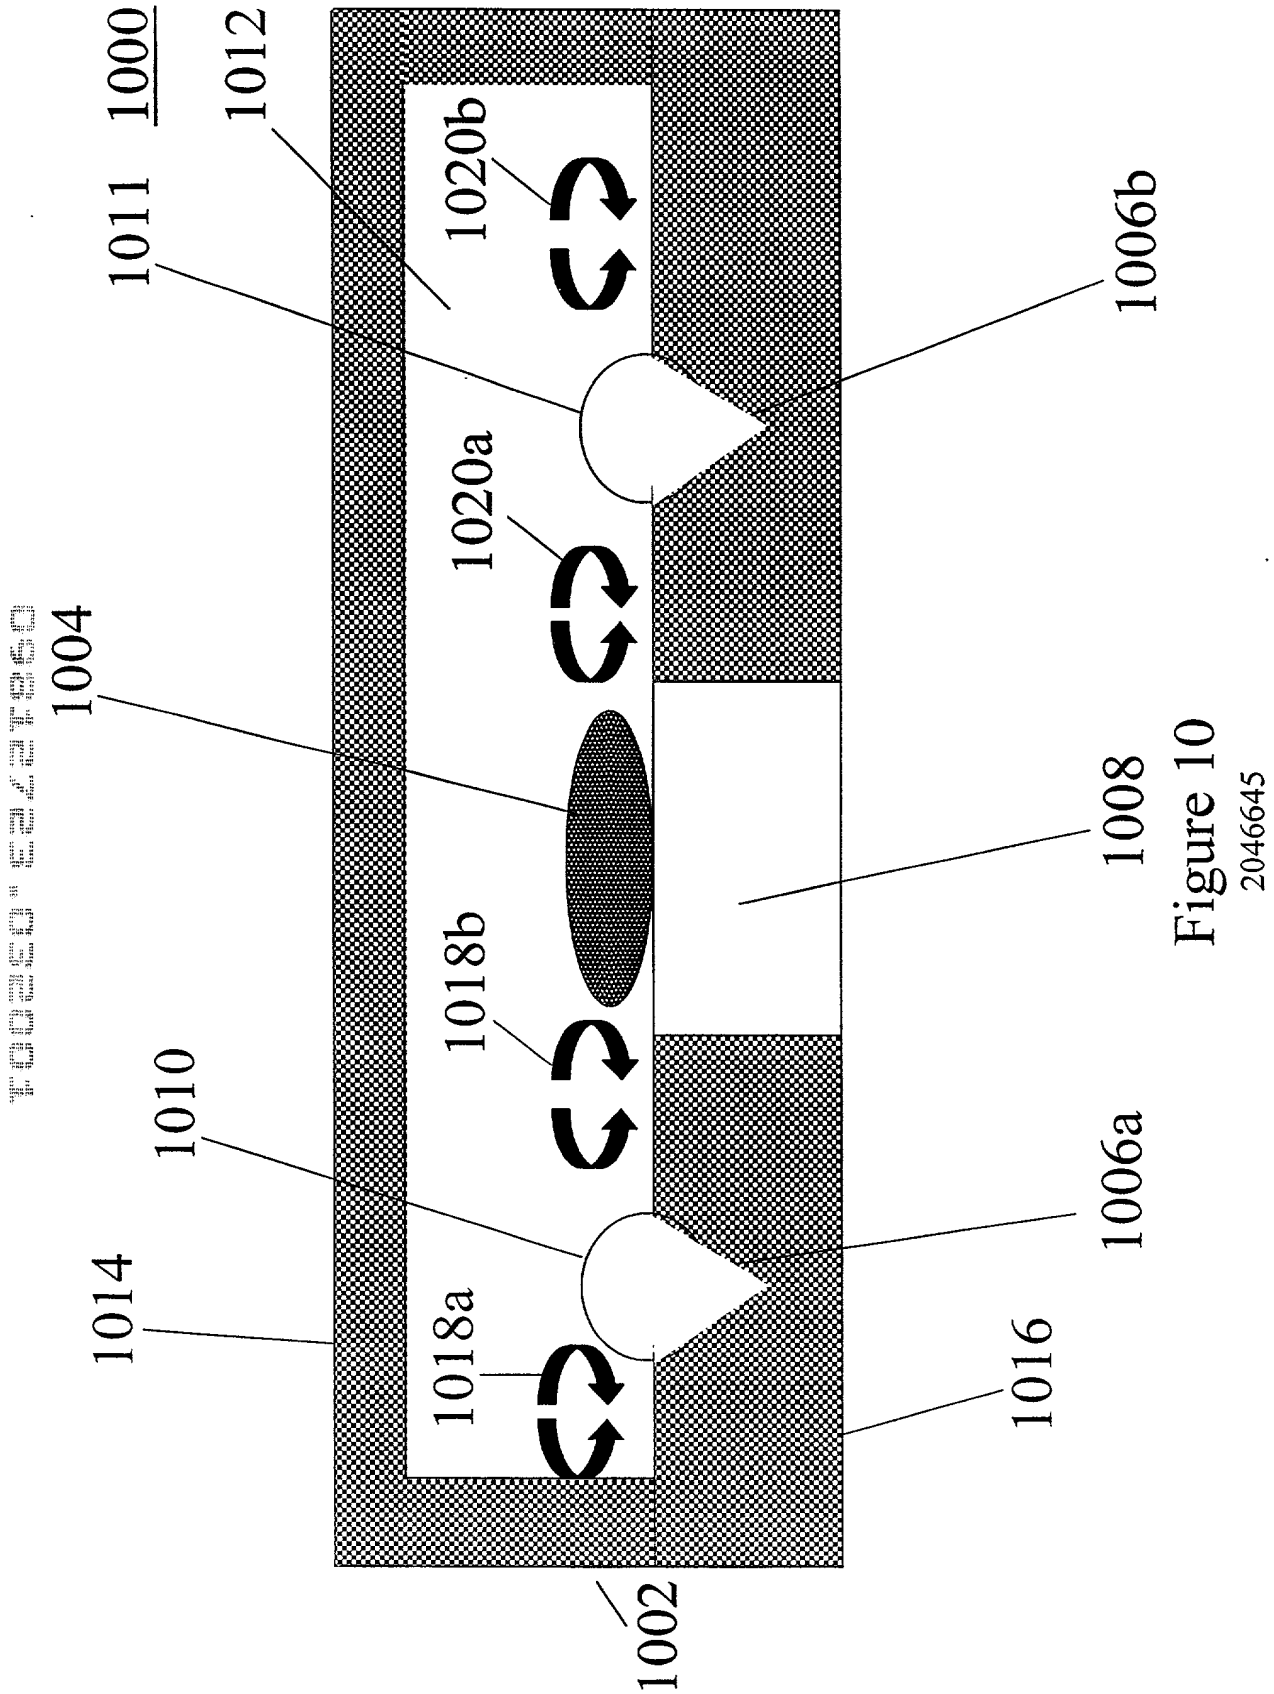


Figure 10  
 2046645



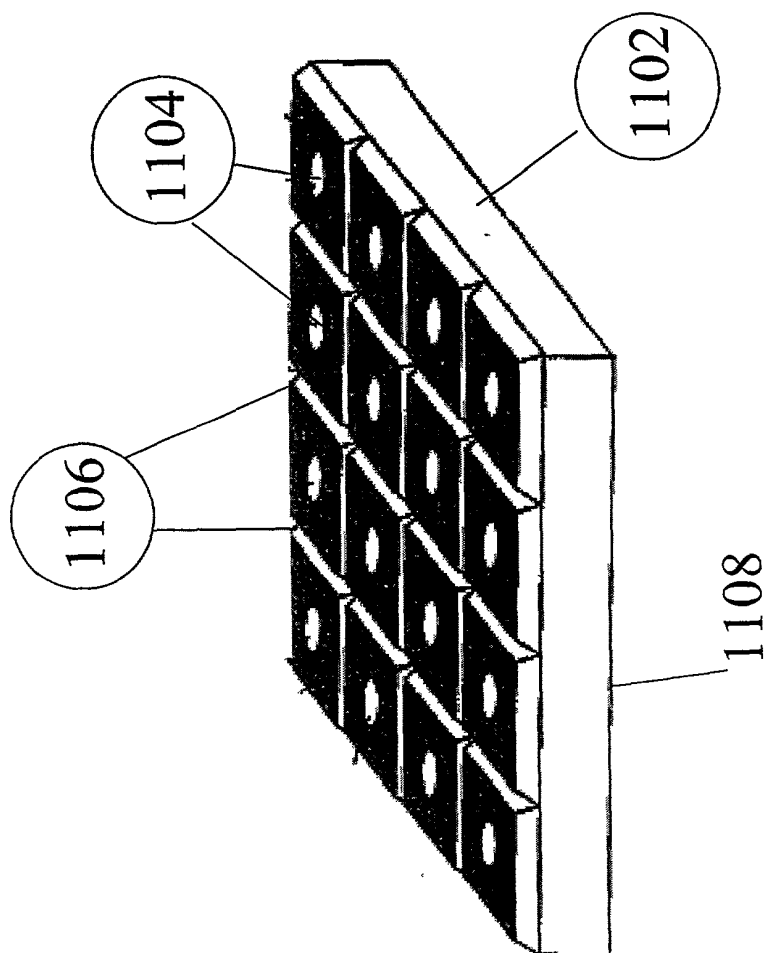


Figure 11

2046645

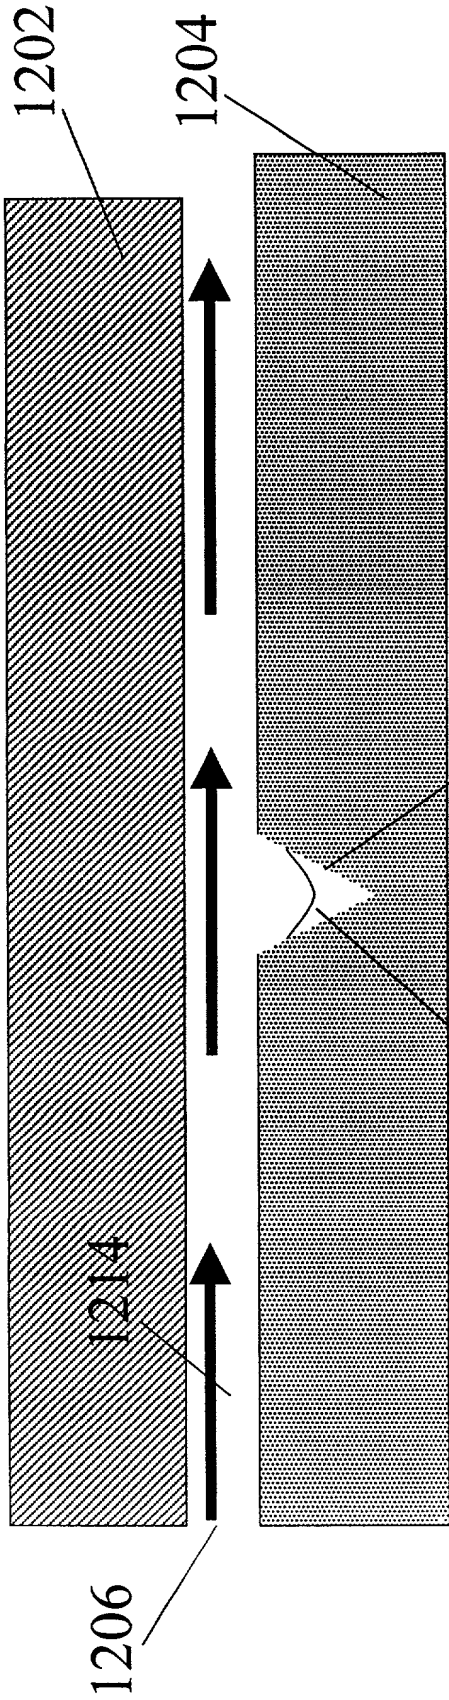


Figure 12A 1208 1210 1212

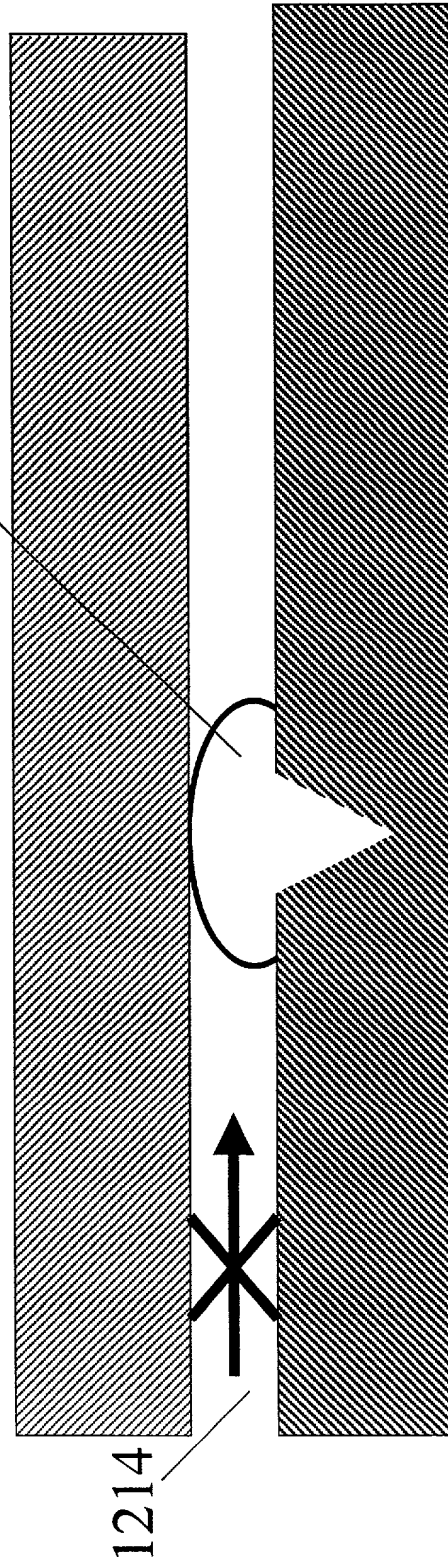
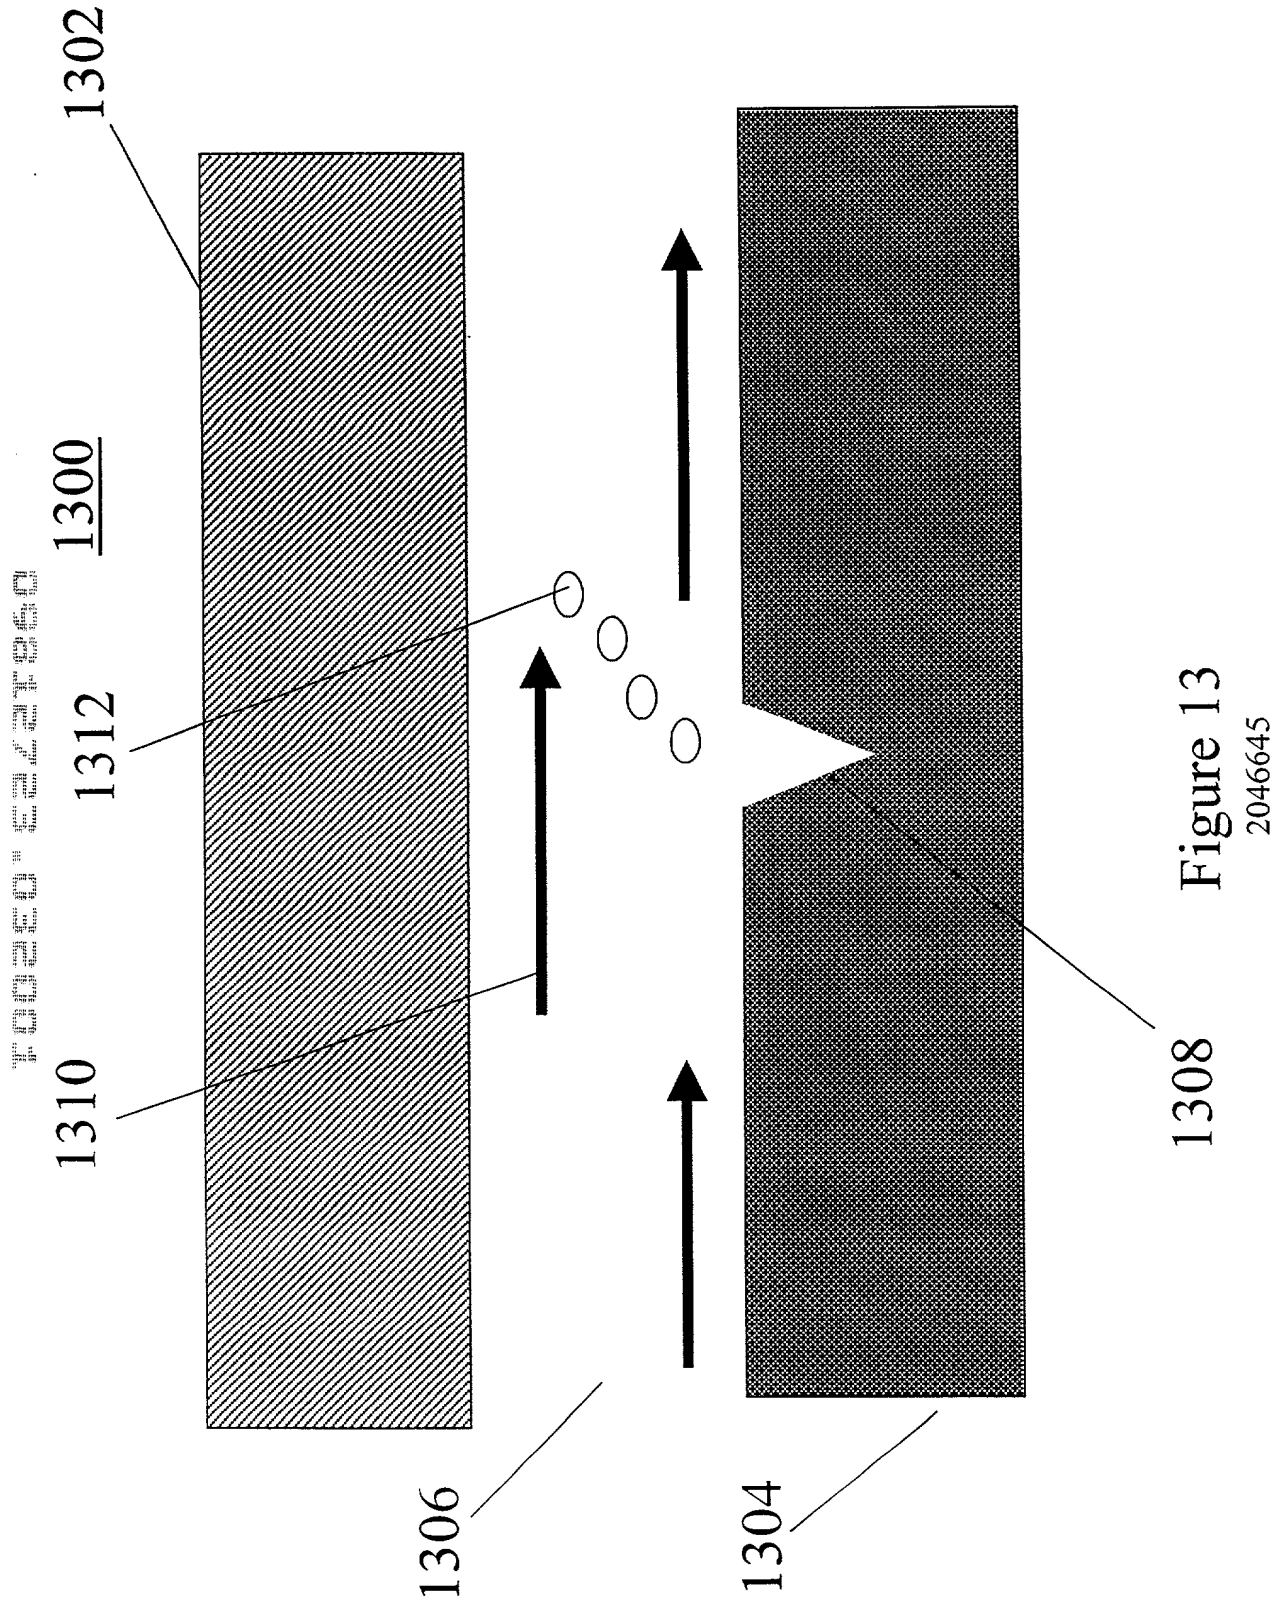


Figure 12B 2046645



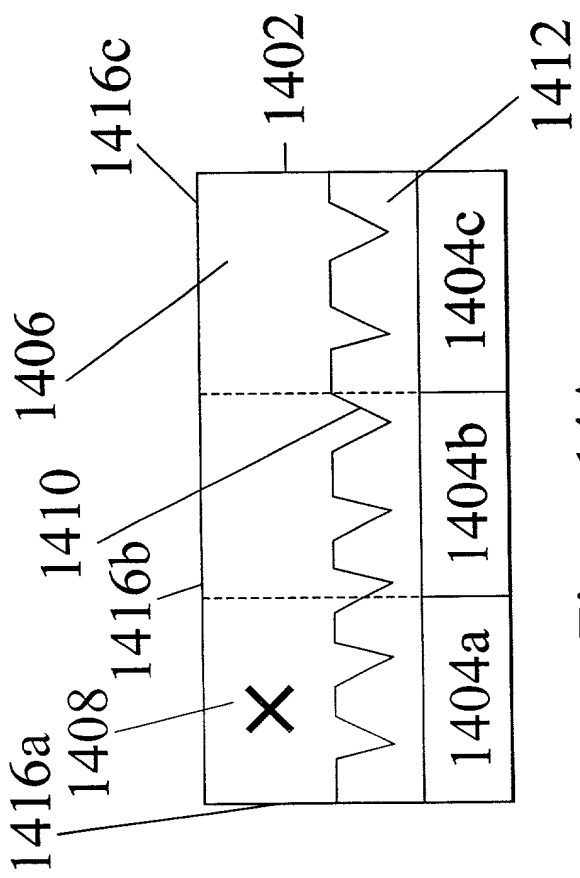


Figure 14A

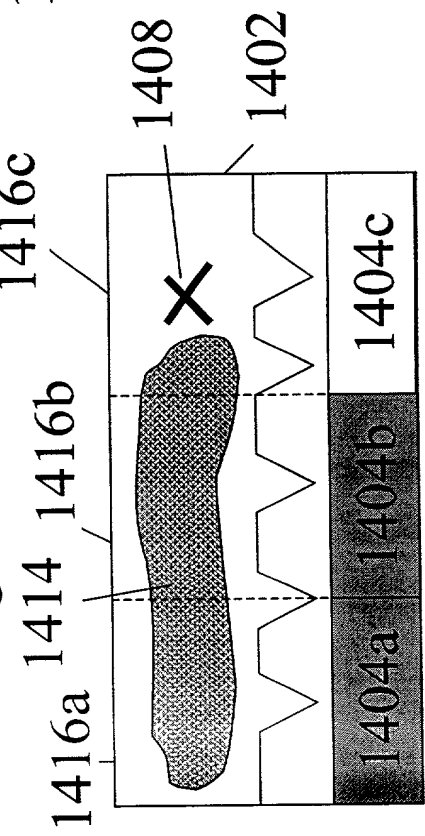


Figure 14B

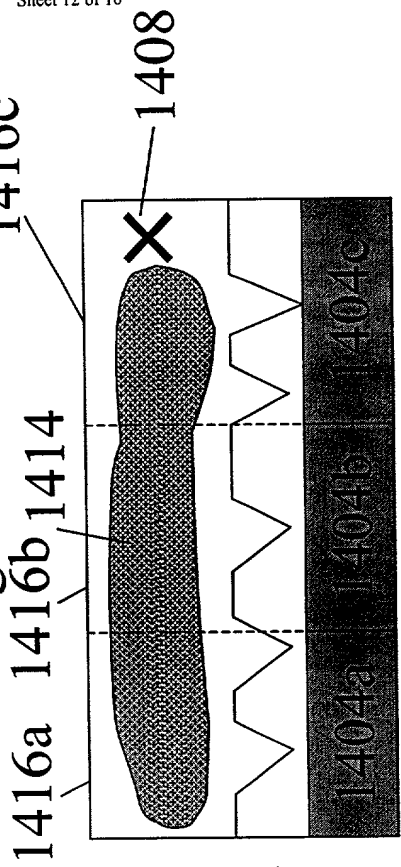
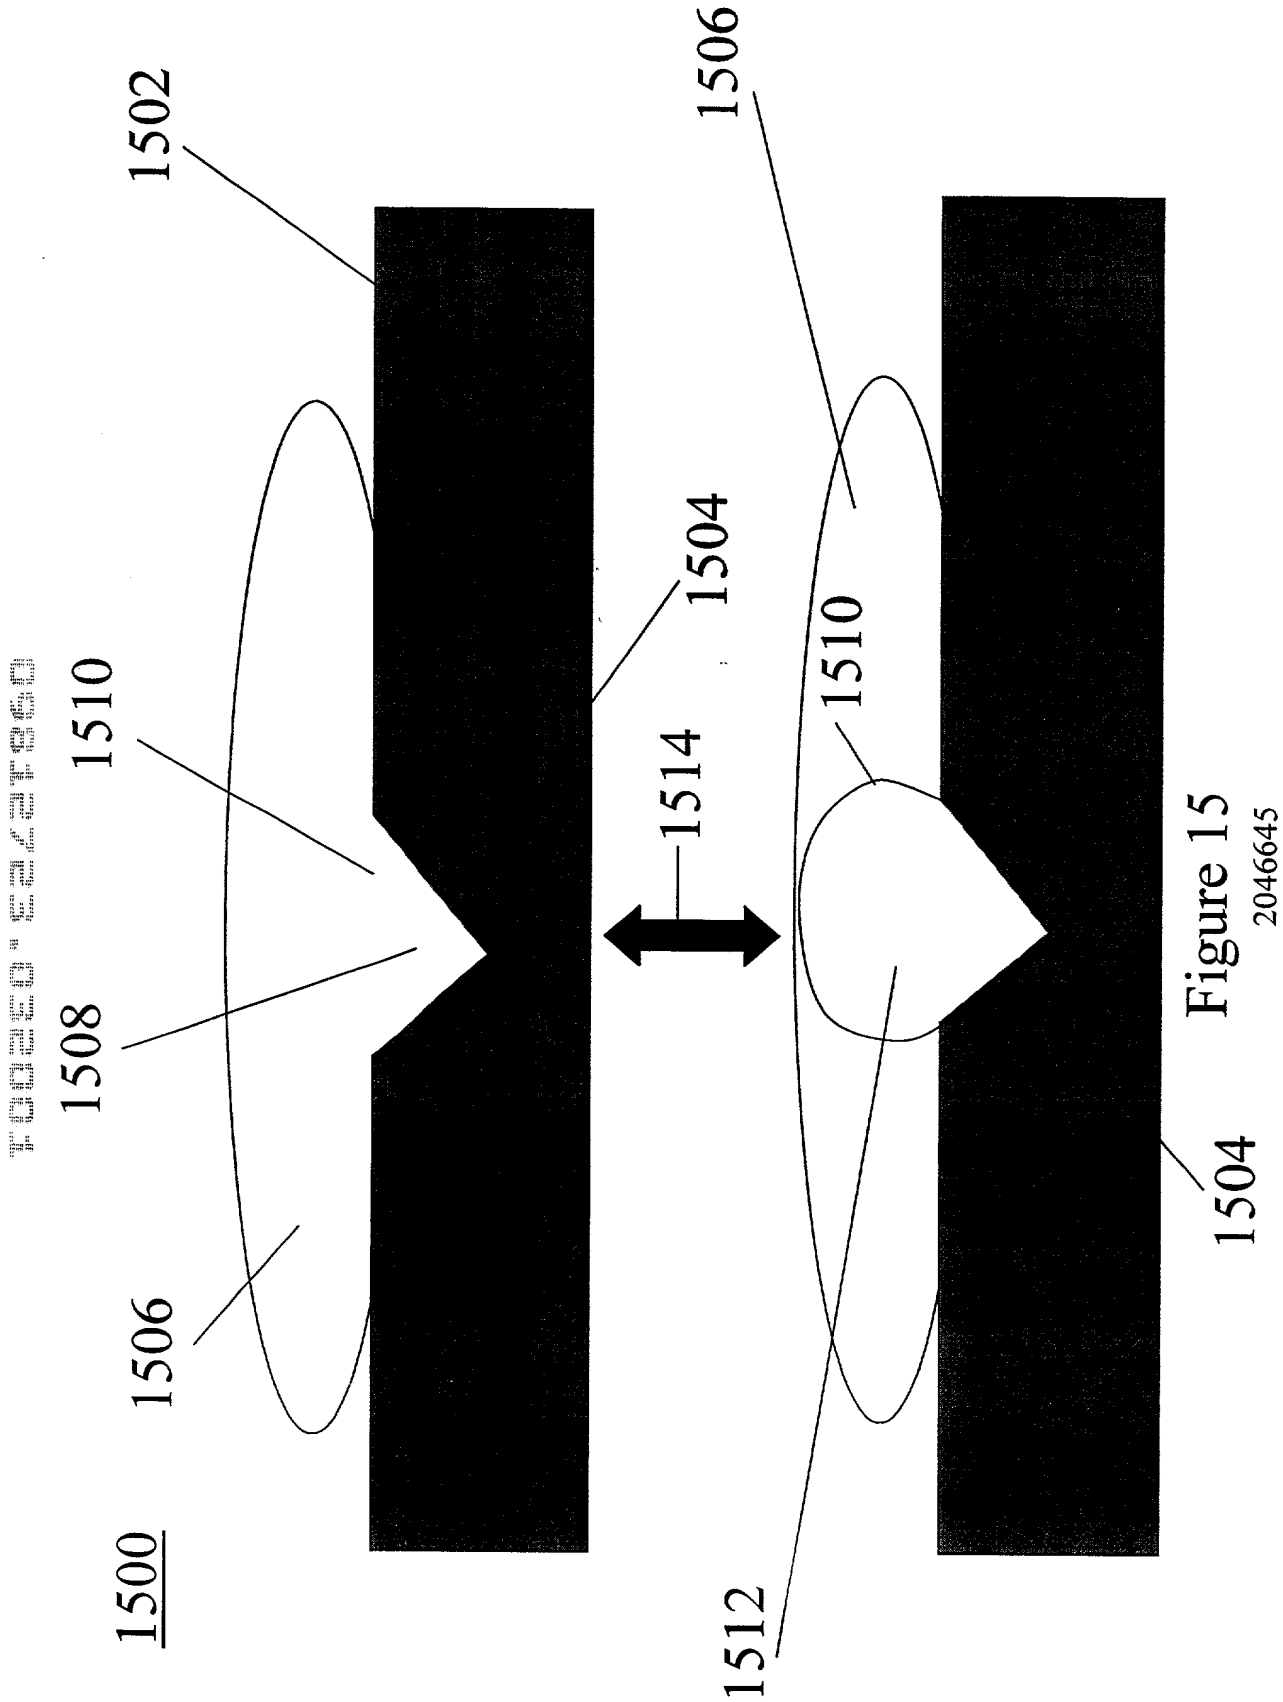


Figure 14C

Figure 14D



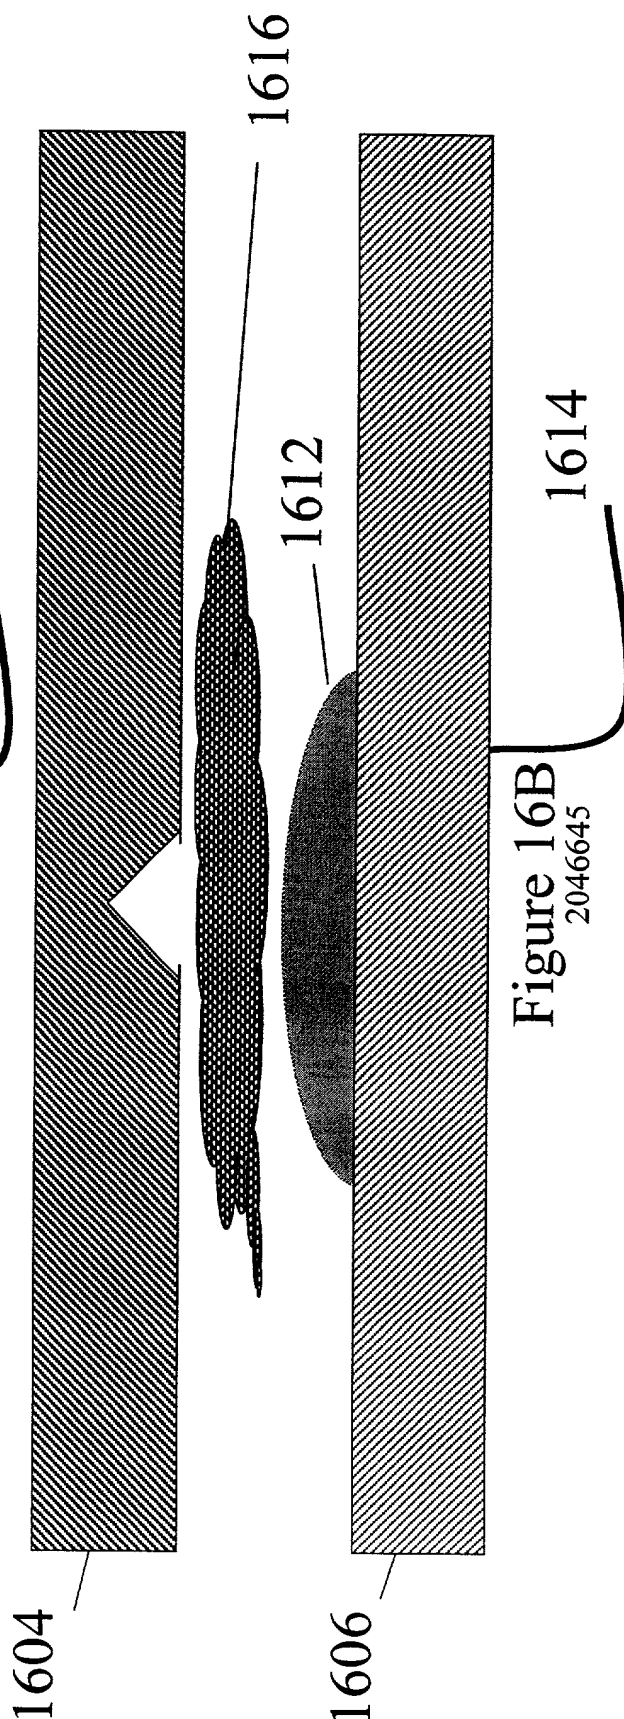
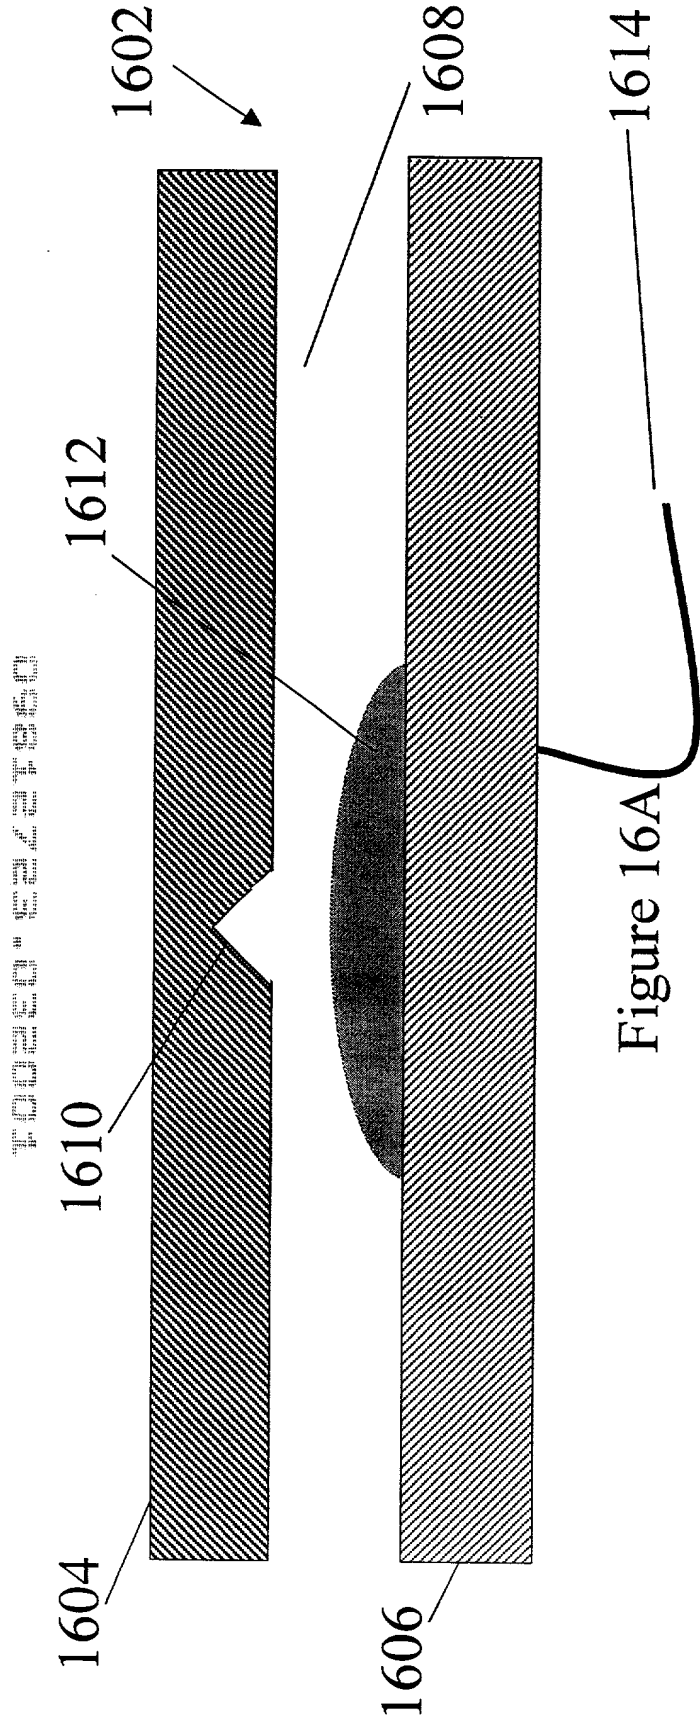


FIG. 17

1700


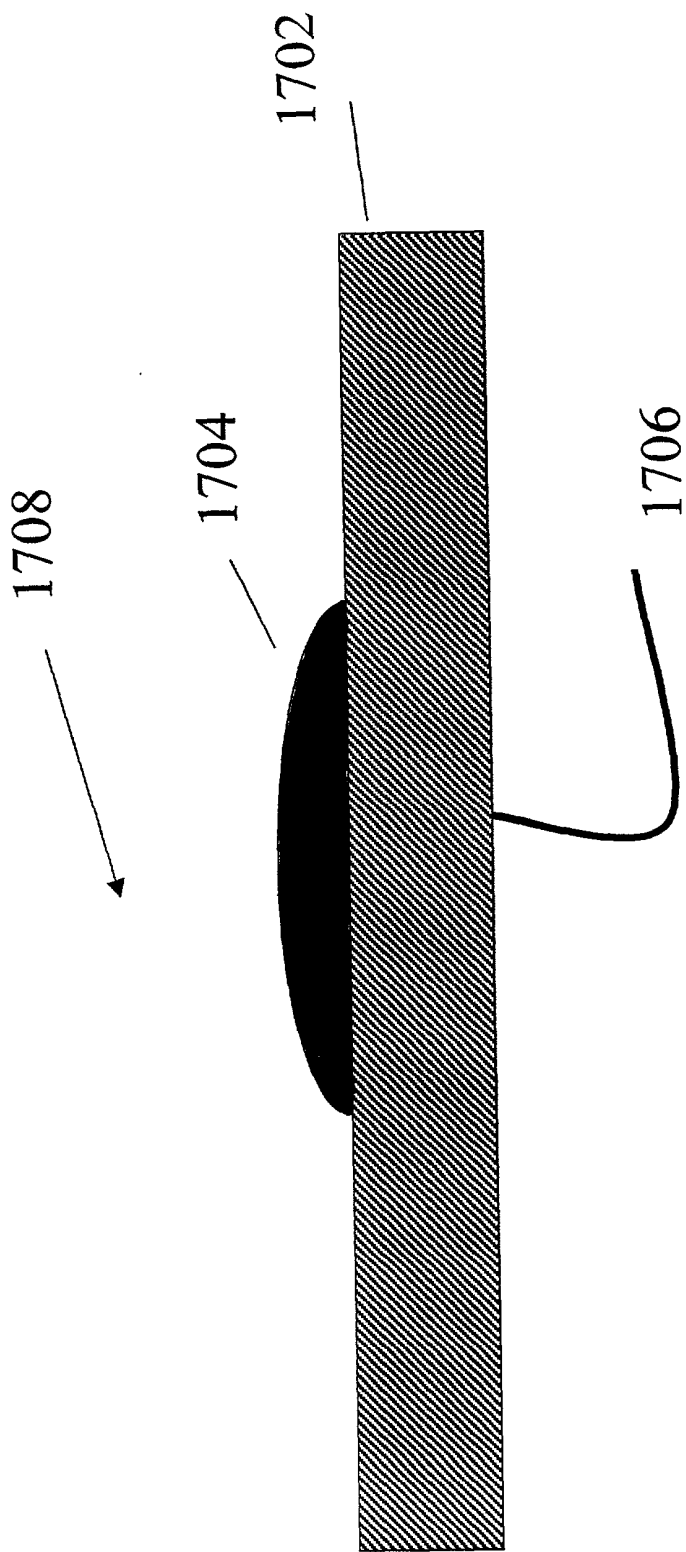


Figure 17

2046645

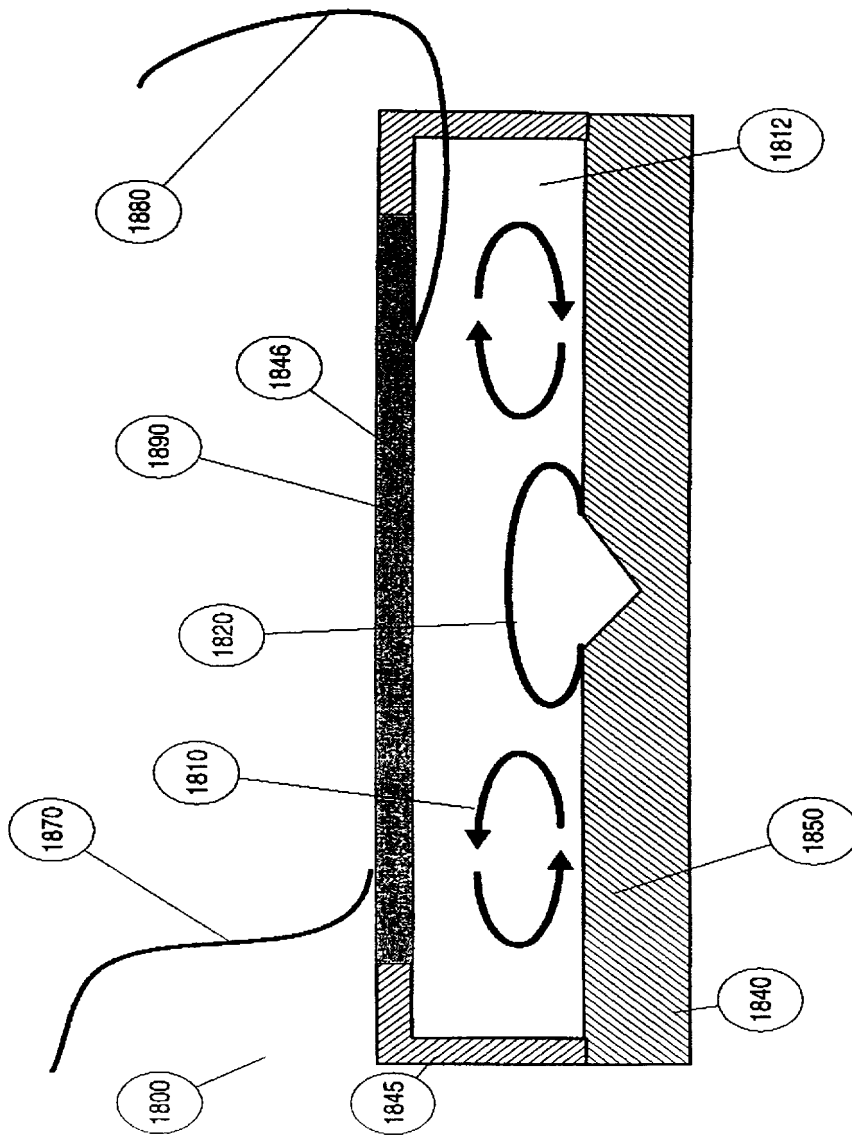

## FIGURE EIGHTEEN

SCANNED, # 14